

PROJECT

**Carrownagowan Windfarm
 110kV Grid Connection**

CLIENT

FuturaEnergy Ireland

CONSULTANTS



NOTES: -

LEGEND: -

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P2	09.11.23	Issued for Planning
P1	01.06.23	Issued for Planning

PROJECT NUMBER


05-641

SHEET TITLE

Joint Bay General Arrangement
 and Passing Bay details

SHEET NUMBER

05641-DR-246

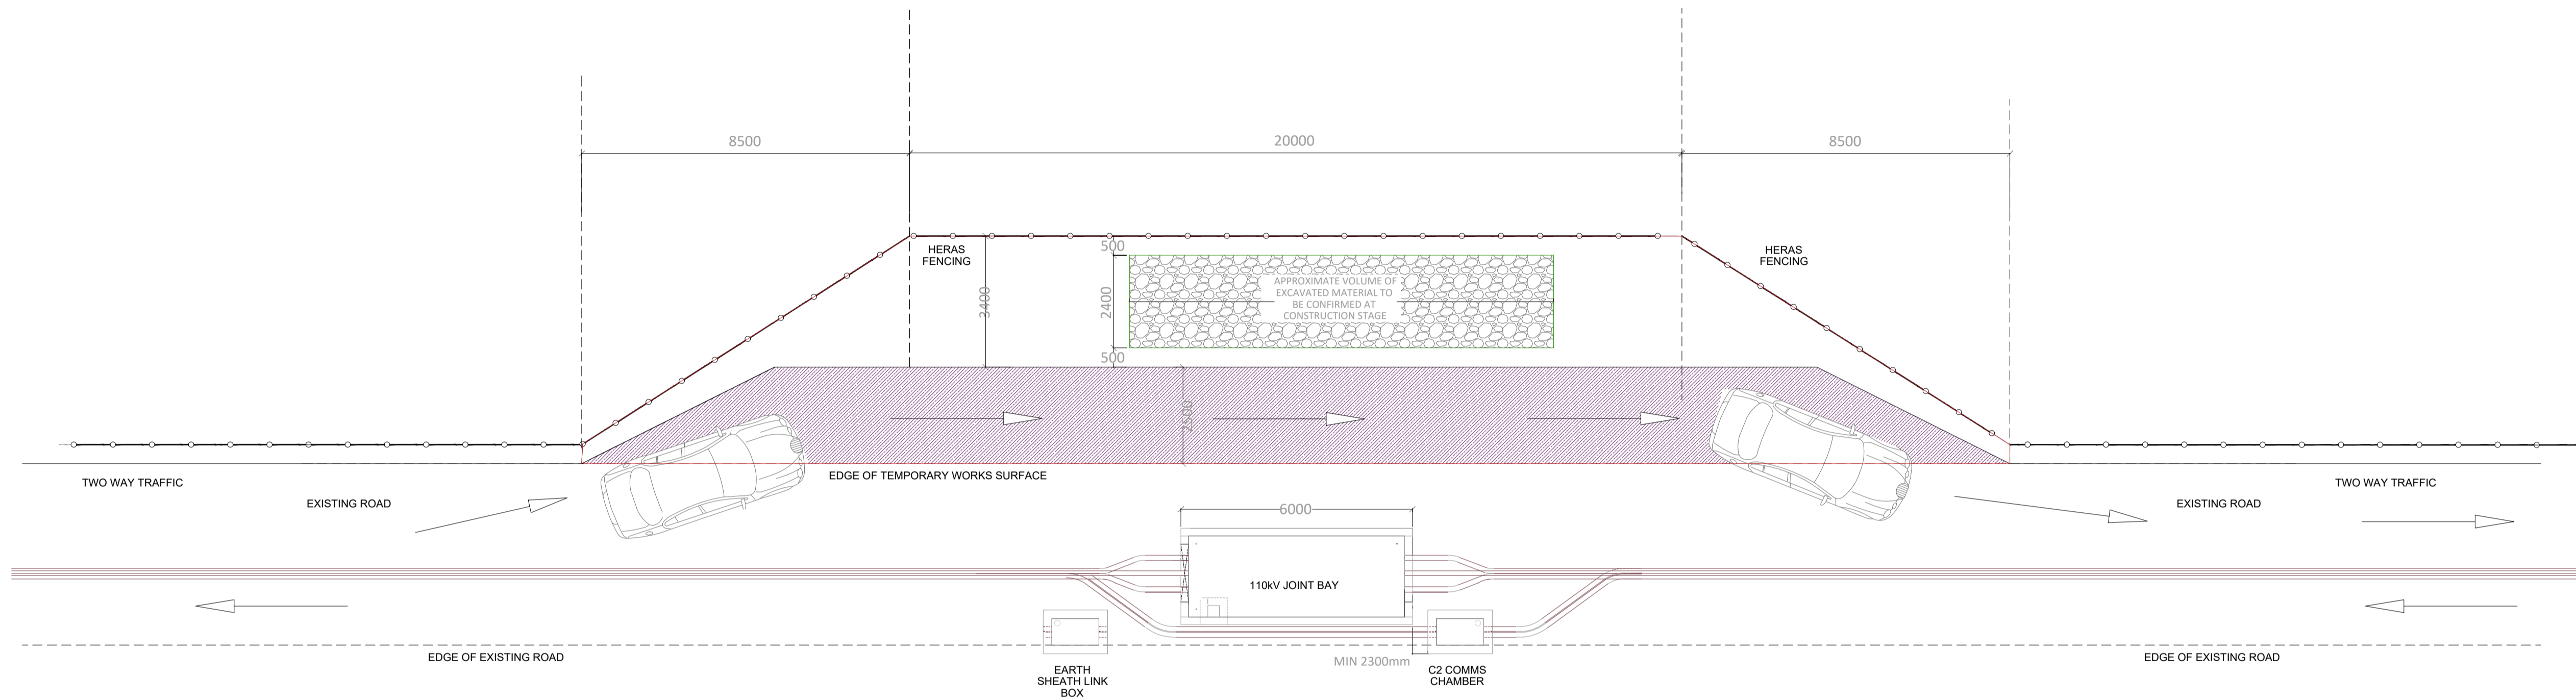

Joint Bay & Passing Bay Arrangement

Scale : 1:1000

GENERAL NOTES:

1. THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE AND IS SUBJECT TO AMENDMENT.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT INFORMATION
3. TEMPORARY HERAS FENCE TO COMPLY WITH NRA DRAWING RCD/3004.
4. THE PROPOSED ENABLING WORKS AREA LAYOUT IS INDICATIVE. LAND ACCESS AGREEMENTS SHOULD BE REFERRED TO FOR EXACT LOCATION OF THE ENABLING WORKS AREA AT EACH PASSING BAY
5. DO NOT SCALE FROM THIS DRAWING. USE ONLY PRINTED DIMENSIONS.
6. IT IS THE CONTRACTOR'S SCOPE TO DETERMINE THE LEVELS OF CUT AND FILL, AND SIZE AND LEVELS.
7. PASSING BAY MAKE UP SHALL CONSIST OF MINIMUM 250MM THICK LAYER OF COMPACTED CL 804 GRANULAR MATERIAL LAID ON 6F 1/2 GRANULAR MATERIAL ON APPROVED GEOTEXTILE liner. EXACT THICKNESS LAYER TO BE DETERMINED BY CONTRACTOR AT EACH LOCATION BASED ON THE CONTRACTOR'S TEMPORARY WORKS DESIGN
8. TRAFFIC MANAGEMENT CONSISTING OF TRAFFIC LIGHTS OR STOP/GO SYSTEM SHALL BE PROVIDED AT EACH LOCATION
9. THE ENABLING WORKS ARE SHALL BE REINSTATED TO MATCH THE ORIGINAL GROUND LEVELS AND PROFILES. FENCE LINES, DRAINAGE AND PLANTING SHALL BE REINSTATED TO MATCH ORIGINAL, OR AS PER THE RELEVANT SPECIFICATION